INOView

Safety at a glance





INOTEC Sicherheitstechnik GmbH Innovative emergency lighting technology



INOTEC Sicherheitstechnik GmbH is a company with the target to create innovative and customer oriented solutions for the emergency and safety lighting market.

In 1999, only a few years after the company was founded in 1995, the new production- and administration buildings with approx. 2.500m², located in Ense-Höingen, were ready for moving in. These buildings had to be expanded by additional 3.400m² only 2 years later, due to the increased demand of INOTEC products. The same happened in 2008, when we had to expand once again by additional 2.800m². Our 3rd expansion started in 2012. New production- and administration buildings of 4.000m² were build up this time..

A dynamic team of highly professional and flexible employees covers all aspects regarding products, engineering and standards

Modern, technical advanced products, "Made in Germany", are setting new global standards like JOKER technology for emergency lighting systems or Dynamic Escape Routing (D.E.R.).

Our products can be found in airports, hotels, stores, office buildings, meeting areas, places of work, We ensure the safe escape from hazardous places in buildings, where a lot of nonlocal people stay.

© Copyright: INOTEC Sicherheitstechnik GmbH, Ense Publications and copies, even partial, only with, manufacturers permission.

Subject to technical changes..



www.inotec-licht.de

2



The new view - INOView

Emergency- and safety- lighting is designed to ensure safety of people in buildings in case of power failure or fire. So this is also guaranteed in case of emergency, safety devices have to be tested, serviced and monitored according to the latest standards. The results have to be logged accordingly.

The new INOTEC monitoring software INOView supports you.

It offers a variety of options to react flexible to demands. The integrated logbook records the system states at any time according to the standards..



- Monitoring of INOTEC emergency lighting systems CPS 220/20, .../64, .../48.1, CLS 24(.1)
- Connection via LAN or INOTEC RTG-BUS
- Failure information down to every luminaire incl. its location text
- Logbook
- Dialogue device failures

W

- Grouping function
- Automatic function/ duration test individually programmable for different levels (project-,group- or

. i

device-level)

- Simultaneous display of several detailed views
- Multiple languages
- Protection against unauthorised access
- Multi-user access
- Client-Server operation
- E-mail report in case of a status change

e

Floor plan visualisation

notec-licht.d







Safety of persons always at a glance

The ease of use was the main focus when developing the visualisation software INOView. Hereby the intuitive user interface was created with clearly structured system overviews and description texts. At just a glance, the user recognises the overall condition of the emergency lighting systems and may optionally quickly take measures to guarantee the safety of

people in the building. The INOView software ensures transparency and provides comprehensive and detailed information on the overall and detailed system status.

Modern client-/server – architecture

The modern and future-proof client-server architecture ensures the security of your investment. Multiple users can access the INOView server simultaneously with all its available information by their locally installed clients. An integrated user management protects the software against unauthorised

Adaptable

Project layouts and requirements always vary. The INOView software can be configured according to your needs and wishes. With its integrated grouping function the display of a project can be personalised. The monitored systems for example can be sorted by location, buildings or responsibilities.

Automated testing

Required tests and maintenance are significantly simplified with the help of automated testing by INOView. You can freely define tests for individual devices, groups or the overall project.

Powerful but comfortable

INOView keeps your emergency lighting systems clearly structured "under control". An intuitive user interface and customisable visualistations ensure the ease of use. INOView grows with its challenge. Whether a school or an airport, with state of the art technology it's focused on the individual requirements of the customer.

Benefits

- Ease of use
- Transparency
- Adaptable, flexible and expandable
- Modern software architecture






Installation examples

Client- and server- components are installed on the same PC. Monitored systems are connected by USB interface (INOTEC RTG-BUS) or network interface. Access is only possible by this PC. Network access is not provided

The three core INOTEC RTG-BUS allows a free topology of lineand star- wiring within a total length of 500m. Different device types can be mixed within one line.

Typical applications: schools, nursing homes, car parks, theatres, cinemas, small industrial companies, etc.

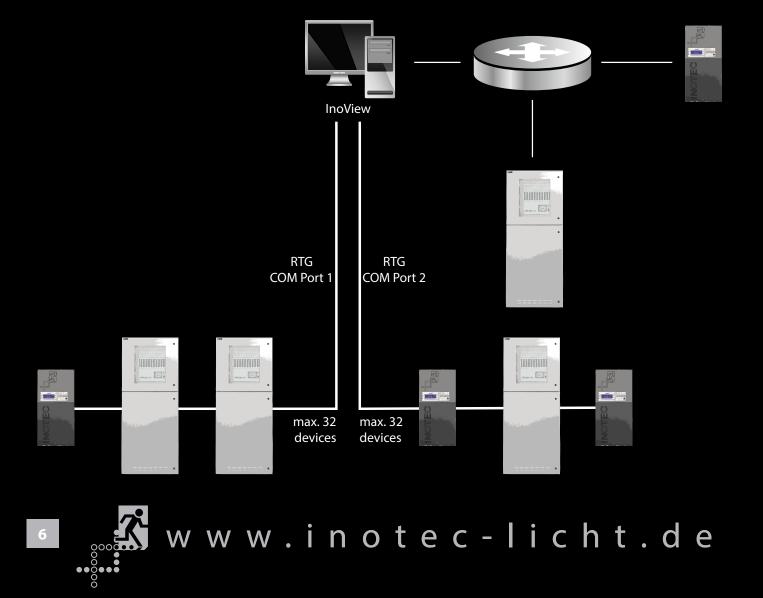




The INOView server components are installed on a physical or virtual server. All users get access via the installed software on their local computers. Multiple users can work simultaneously with this network installation. Several systems are connected to the server via INOTEC RTG-BUS. Simultaneously additional devices are monitored via network.

It's possible to realise a cross-site monitoring via corporate network. This is especially interesting for industrial or logistics companies with multiple locations that favour a centralised monitoring or for the public sector with a central facility management, who is responsible for several locations.


The three core INOTEC RTG-BUS allows a free topology of lineand star- wiring within a total length of 500m. Different device types can be mixed within one line

Typical applications: public sector, hospitals, industrial companies, airports, logistics centres, etc.

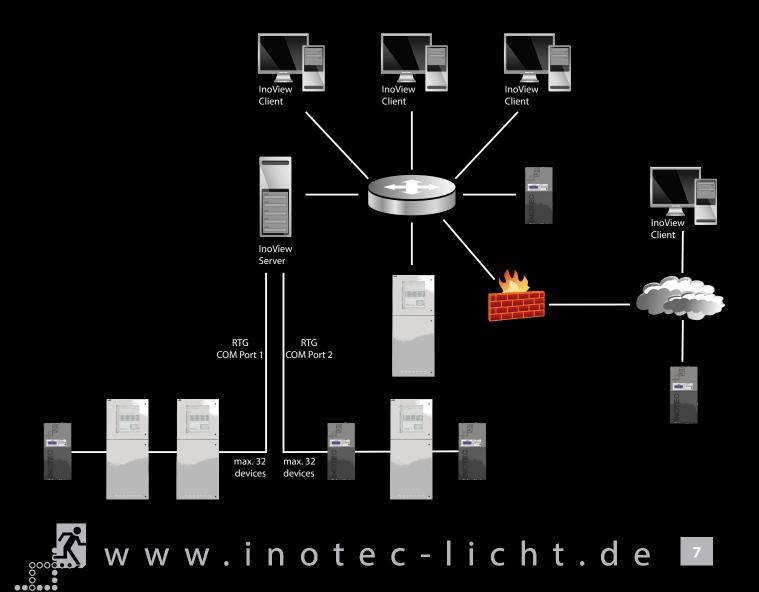




User interface overview

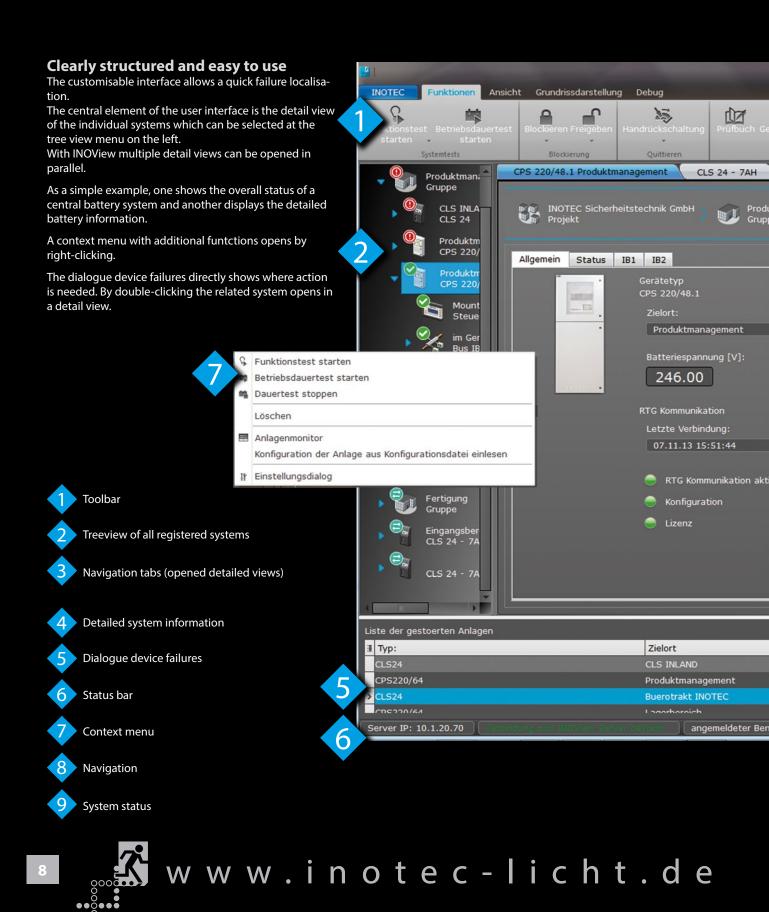




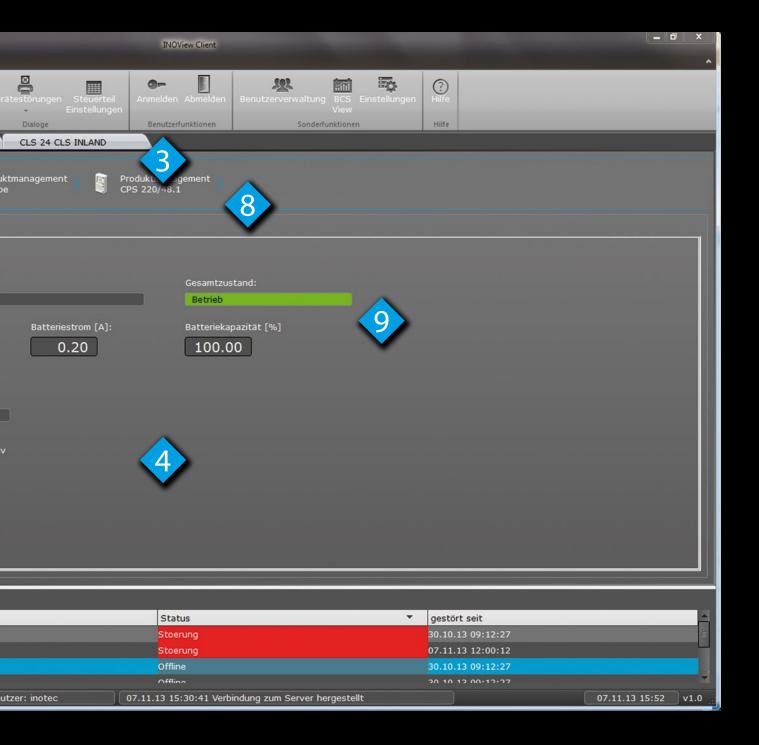






Floor plan visualisation

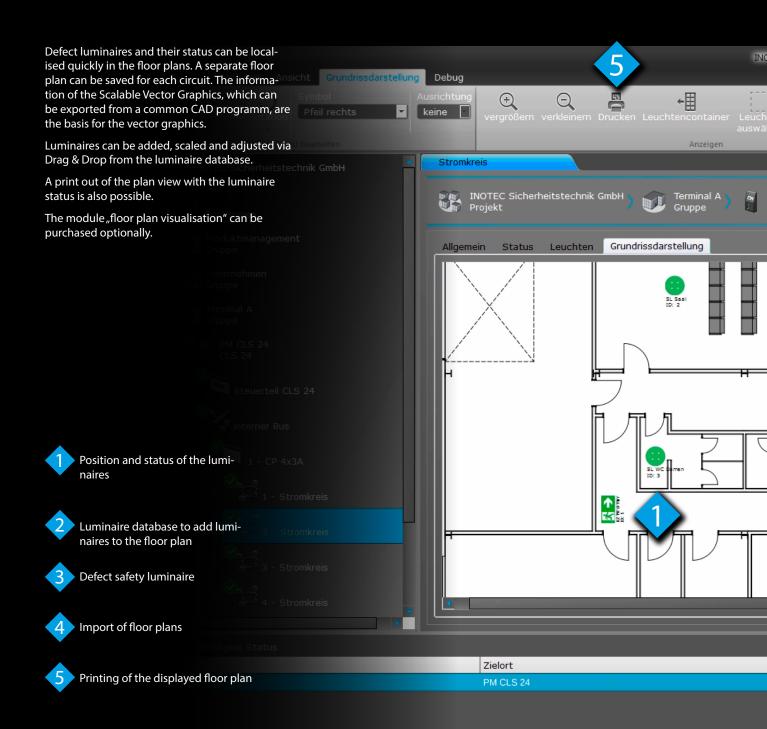


1.6.60 Verbindung zum INOView Server besteht

angemeldeter Benutzer: techniker





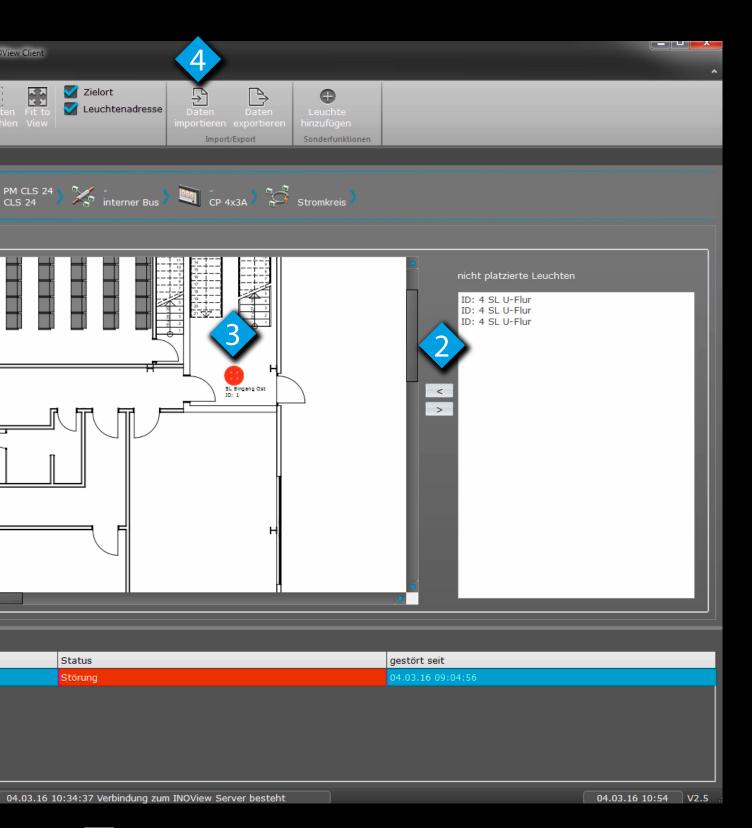






Analysis, logbook, failure overview



Simultaneous display of several detail views.

Verwaltung 3. CG CPS 220/64	CLS 24 CLS Vernalturg	Dialoge 2			
Produktmanagoment CPG 220/46.1	INUTEC Sicherhaltstechnik GribH Projekt	Linger Gruppe	015 220/04 × 0	roduktion vs 201	
C.S. Verwaltung 1 C.S. 24	main Einschübe				
CLS Verwaltung 1 TTT Stauentel CLS24					
Verwaltung internet Bus	Adresse Bild	100.04	Typ:	zielort:	status
Latterie 2		18			Recheo
Lagar Gigga		F		Produktionsbereich 1	840140
Lagetenich Cr5 220/b4		ß			807740
U3-HV04-S8 C/5 220/H		15		Produktorsbereich 2	uetres
UL-INO4-SU		B			Betrieb
Production But (0)		15		Produktionsbereich 3	terreb
Produktionsbereich 1		B			Betrieb
Or Prochationshormath 1 2 - CP 2146		15		Produktor oberwich 4	Rect ed.
Produktionsburech 1		ß			Becriec
Cy invasionaborach 2		15		Produktion UG	e07140
Contractions and a second and a second		ß			Setted
Chi Produktionsberreich 3			CP 452A		Debreb

Freely sortable table views. A doubleclick on an entry opens more details.

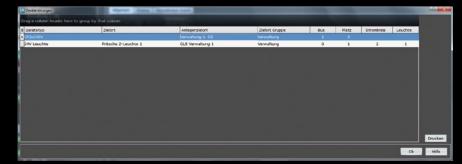

The dialogue device failures shows all systems in failure condition. By doubleclicking the related detail view opens – troubleshooting in a simple and fast way.



INOView Prüfb	ouch	when I down	all and a local division of the					Statement of the local division of the local	? ×	Clear logbook with filter
Tabellenansich	ht Detailansi	cht								function for all entries. These
Drag a column	n header here to	o group by th	at column					Anzahl Einträge alle Einträge		can be freely sorted within the
Eintrag	Datum	Uhrzeit	Anlage	Anlagenzielort	5	Port	Ereignis	Von		
1					:hungsr 1		BCS Modul, kein BCS programmiert	07.01.2014		table. Printing is also possible.
2	06.01.2014	15:09	CPS220/64	Produktmanager	ment C	OM3	BCS Modul, kein BCS programmiert	Dis		
3	06.01.2014	15:09	CPS220/64	Produktmanager	ment C	OM3	Anlagenstörung	1977 C		
4	06.01.2014	15:09	CPS220/64	Produktmanager	ment C	OM3	Platzstörung	07.01.2014		
5	07.01.2014	02:01	CLS24	CLS Verwaltung	2 0	OM3	Funktionstest Fehler	Ereignis		
6	07.01.2014	05:09	CPS220/64	Zielort/placetex	t 1	0.1.5.128;7	Funktionstest OK	alle Ereignisse		
7	07.01.2014	05:38	CPS220/48.1	Produktmanager	ment C	OM3	Funktionstest OK	Anlage		
8	07.01.2014	06:09	CP5220/64	Schulungsraum	1	0.1.6.11;7	Funktionstest OK	Alle Anlagen		
9	07.01.2014	09:42	CPS220/64	Verwaltung 1. 0	G C	OM3	BCS Modul, kein BCS programmiert	Port		
10	07.01.2014	09:42	CPS220/64	CPS-64-Bespred	hungsr 1	0.1.5.129;7	BCS Modul, kein BCS programmiert	Alle Ports	*	
11	07.01.2014	09:42	CPS220/64	Verwaltung 1. 0	ig c	OM3	Anlagenstörung			
12	07.01.2014	09:42	CP5220/64	Verwaltung 1. O	G C	OM3	Platzstörung	Filter anwende	en	
13	07.01.2014	09:43	CLS24	CLS Verwaltung	1 0	OM3	Anlagenstörung			
14	07.01.2014	09:43	CLS24	CLS Verwaltung		OM3	Platzstörung	Drucken		
15	07.01.2014	09:43	CI 524	CLS Verwaltung	1 0	OM3	Stromkreis Störung	•		
Tabellenansic		cht						Anzahl Einträge		All entries can be grouped and filtered several times by the
Eintrag	A Datum		hrzeit A	Inlage	Port	Ereig	nie	alle Einträge		
	lort: CLS Verwa		in zen	inage	Port	ereig		Von		given columns. For example:
13	07.01.2	CONTRACTOR OF A	:43 CI	1524	сомз	Anlan	enstörung	01.01.2014		Entries can be grouped by
14	07.01.2				COM3		störung	Dis		device location and events.
15	07.01.2			and the second sec	COM3		ikreis Störung	07.01.2014		device location and events.
16	07.01.2				COM3		nten Störung	Ereignis		This leads to simplified trouble-
	lort: CLS Verwa							alle Ereignisse	1.1	
s	07.01.2		2:01 CI	L524	сомз	Funkt	ionstest Fehler	Anlage		shooting.
Anlagenziel								Alle Anlagen		
1	05.01.2	and dependence of the second		PS220/64	10.1.5.129	7 BCS M	Modul, kein BCS programmiert	Port	164	
10	07.01.2			and the second	10.1.5.129		Modul, kein BCS programmiert	Alle Ports		
	lort: Produktma		-							
2	06.01.2		5:09 CI	P5220/64	сомз	BCS N	Modul, kein BCS programmiert	Filter anwende	en	
3	06.01.2				сомз		enstörung			
4	06.01.2				COM3		störung	Drucken		
7	07.01.2				COM3		ionstest OK	×		
								Ok	Hilfe	2 INOView Prüfbuch
<u>u</u>		-								Tabellenansicht Detailansicht

More information can be shown by the detail view. Individual luminaire failures are displayed incl. location texts and can be printed out.



13





INOView Battery monitoring

An exacty analysis of the recorded data is possible due to the integration of the Battery Control System (BCS) monitoring single battery blocks within the INOView Software.

Diagrams visualise the state of the voltage and temperature of the battery blocks. The BCS records the measurements data on a daily basis and before every duration test. To present the information clearly the BCSView-Software is used, which can be directly activated at the INOView-Software.





User interface overview



Filtering function

Battery block temperature-/voltage within a time frame





Voltage drop of the battery blocks

The supported systems need to be connected via network for the usage in combination with the INOView Software.





INOView E-Mail-Notification

With the integrated E-Mail-function the recipient will be automatically informed in case of a failure, power failure or after a function test.





Everywhere in use

INOView supports you in all concerns, to ensure personal safety and to simplify the maintenance of the emergency lighting systems.

Schools & Universities

Schools and universities are frequented by hundreds or thousands of people every day. The emergency lighting systems have to be monitored 24/7, to guarantee its correct functionality during hours of operation. The use of INOView as a centralised monitoring system is optimising the tasks of the facility manager, as the emergency lighting systems are often localised in several locations, within one project.

Emergency lighting systems can be blocked during hours out of business and can be re-activated for events in the evening. This helps to reduce operating costs and avoids situations of unnoticed battery discharging.

Transport & Traffic

Airports and train stations are frequented by a huge amount of passengers 24/7. Dangerous events and emergency situations lead to panic reactions very quickly. The emergency lighting system has to be in a very well condition to guide people out of the building in a save way. Projects like these contain thousands of lighting points, which have to be monitored by a central building management. INOView is demonstrating its strengths by a clear structure in projects like these. Your daily work will be assisted by individual grouping possibilities and a clear overview of system failures, including filter functions.

Public buildings, theatres & meeting areas

Public buildings, theatres and meeting areas are daily used by nonlocal people. Escape routes have to be clearly marked to guide these people out of the building in case of emergency.

INOView is your tool to simplify the maintenance of the emergency lighting system and to guarantee the safety inside of the building.

Logistics & Industry

16

A central electrical workshop has to take care of the maintenance of several buildings at several locations. This requires a lot of time. The central monitoring by INOView supports you in reducing workload by important information and clearly structured messages. Complexes of buildings or locations can be combined into freely defined groups. Areas with system failures will be highlighted independent of the system types.









INOView Software

Monitoring system



Visualisation software INOView, for centralised remote monitoring of INOTEC emergency lighting systems. The client-/ server- architecture allows access of multiple PCs within the network. The essential version of INOView includes logbook, failure information, automatic tests and 10 system credits for INOTEC emergency lighting systems.

System requirements

Server:

Operating system:	Microsoft Windows 7, Windows 2008 Server, Windows 2012 Server, Windows 10
Processor:	Intel or AMD
Memory (RAM):	min. 2GB
Interfaces:	USB* , maybe RS 232
Network:	TCP/IP

Client:

Operating system:	Microsoft Windows 7, Microsoft
	Windows 8, Windows 10
Processor:	Intel or AMD
Memory :	min. 2GB
Network:	TCP/IP

* Required for USB-Dongle

The INOView system credits upgrade is available to monitor additional INOTEC emergency lighting systems. It's possible to purchase single system credits.

INOView licensing

The INOView software has to be licensed according to the amount of monitored INOTEC emergency lighting systems. The amount of needed system credits depends on the different device types.

Device type	System credits per device
CPS 220/64, CPUS 220/64, CPS 220/48.1, CPUS 220/48.1, CPS 220/48, CPUS 220/48 CPS 220/20	3
CLS 24/CLS 24.1, CLS 24-7Ah	1

INOView – Essential software package Art. Nr. 185 405



INOView – system credits upgrade Art. Nr. 185 406

INOView floor plan upgrade

Art. Nr. 185 413





www.inotec-licht.d 17 е

INOView accessories

Components



Standard network interface to INOTEC RTG-BUS for connection of INOTEC emergency lighting systems. RJ45 interface for connection to existing ethernet. Suitable for DIN-rail mounting.

Technical data

Material: Nominal voltage: Power consumption: **Terminals:**

Temperature ta: **Protection category:**

Protection class:


Acc. to DIN EN 55015

Polycarbonate 24V ±10% 1,7 VA 2,5mm² single-core 1,5mm² multi-core with ferrule -15°C...+40°C IP20 Ш

INOLan.1

Art. Nr. 990 063

DIN rail mounting






RTG interface for connection of up to 32 INOTEC emergency lighting systems to a PC by USB- or serial RS232- interface. Included in delivery: 1x Power supply

1x Connection cable 1m

1x Driver-CD for RTG – Interface (USB)



RTG - Interface (RS 232)





optional accessory

Technical data

Material:				
Nominal voltage:				
Terminals:				
Temperature ta:				
Protection category:				
Protection class:				
Acc. to DIN EN 55015				

Polycarbonate 230V ±10%, 50/60Hz 2,5mm² -15°C...+40°C IP20 ||/|||

optional accessory Art. Nr. 851 044 0 80 M 0

124



e



-25

INOView accessories

Components



Dongle Device Server for integration into a virtual network environment. This component is needed, if the INOView server is installed on a virtual machine. The integration is done by network connection and a software within the virtual machine..

Dongle Device Server

Art. Nr. 185 050

optional accessory



INOView ZLT-Interface

Art. Nr. 990 227

optional accessory



Technical data

Material: Nominal voltage: **Terminals:** Temperature ta: **Protection category:** Protection class: Acc. to DIN EN 55015

Polycarbonate 230 V ± 10%, 50/60 Hz 2,5 mm² -15 °C ... +40 °C IP30 III

The IB-Interface is a communication interface between INOView(180405) and ZLT-Interface(990227). Included in delivery: 1 x Power supply 1x Connection cable 1m 1 x Driver - CD


Technical data

Material:	Ро
Nominal voltage:	23
Terminals:	2,5
Temperature ta:	-15
Protection category:	IP2
Protection class:	II/I
Acc. to DIN EN 55015	

olycarbonate 30 V ±10%, 50/60Hz 5 mm² 5 °C ... +40 °C 20 Ш

Art. Nr. 851 049

IB-Interface (USB)



optional accessory





19

System requirements

Operating systems:	32/64-Bit: Windows XP, Windows 7, Windows 8, Windows Server
	2008, Windows Server 2012
Network interfaces:	10BaseT/100BaseTX/1000BaseT
Interfaces:	2xUSB 2.0

for operation, failure (general) and 2 freely.

INOView ZLT-Interface to communicate fault reports to the

Installed in distribution board, incl. power supply (146030)

existing BMS. Suitable to connect to a remote switch as well as

to loop monitoring. Five potential free contacts programmable

2012 00BaseT



INOTEC Sicherheitstechnik GmbH Am Buschgarten 17 59469 Ense

> Tel +49 2938 9730-0 Fax +49 2938 9730-29

> > info@inotec-licht.de www.inotec-licht.de

> > > 00500

()

 \bigcirc

ð.

